



WATER STORAGE TANK CLEANING & DISINFECTION REPORT

Client Name: International Indian School

Location : Abu Dhabi , UAE

Cleaning Date: 26th April 2024



INTERNATIONAL
INDIAN SCHOOL
ABU DHABI

Submitted to: **Mr. Riyas Parayil**
(Admin Supervisor/OSH Officer)

Submitted by: **Sarfaraz Faiz Ahmad**
(General Manager)



CERTIFICATE OF CLEANING AND DISINFECTION

This Cleaning and Disinfection Certificate is issued to:

International Indian School

Located at: Abu Dhabi, United Arab Emirates

We, Quality Care Building Cleaning Services LLC, hereby certify that we have accomplished cleaning and disinfection of the water storage tanks at *International Indian School*.

Location, Type & Size of Tank : Filter Water Cooler- 6nos.

Cleaning Frequency as per client Requirement : Every 6 months

Date of Cleaning : 26th April 2024

Validity of Certificate : 6 Months from date of issue

Under Reference Number : QC-2Q/ WT

Chemical Used : **HygienX**

The procedures applied in this cleaning and disinfection of water storage tanks comply with QCBCS methodology and Technical Guidelines for Legionella control in water system

DM-HSD-GU44-LCWS2.

Next Cleaning as per client requirement: 25th October 2024

Note: We are not giving any warranty for the cleaning works, once we submit the report & we are giving validity only for certificates.



Signed on behalf of

QUALITY CARE BUILDING CLEANING SERVICES LLC



كواليتي كير للخدمات تنظيف المباني ش ذ م م

QUALITY CARE
BUILDING CLEANING SERVICES LLC

القاهرة - مصر - 11511 - 11511 - 11511

International Indian School

Filter Water Cooler

WATER TANK CLEANING& DISINFECTION






كواليتي كير للخدمات تنظيف المباني ش.م.م
QUALITY CARE
BUILDING CLEANING SERVICES LLC

المحافظة - أبوظبي - الإمارات العربية المتحدة

International Indian School

Filter Water Cooler

WATER TANK CLEANING& DISINFECTION

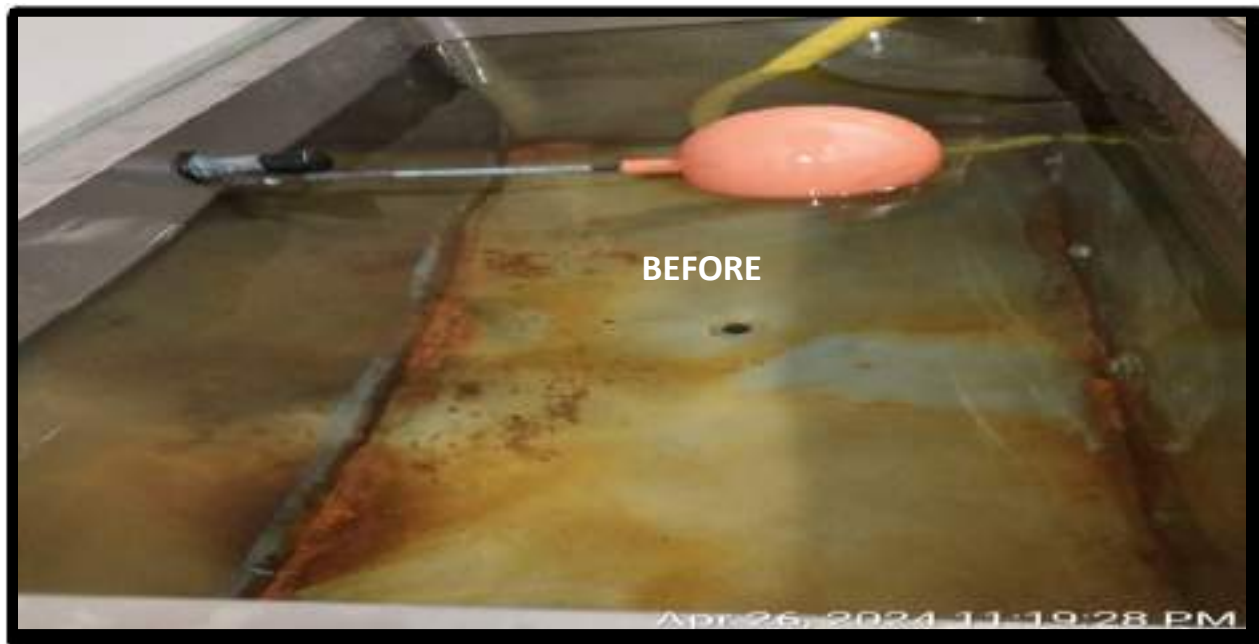



كواليتي كير للخدمات تنظيف المباني ش.م.م
QUALITY CARE
BUILDING CLEANING SERVICES LLC

Abu Dhabi - Dubai - Ras Al Khaima - Ajman - U.A.E.

International Indian School

Filter Water Cooler

WATER TANK CLEANING & DISINFECTION





كواليتي كير للخدمات تنظيف المباني ش.م.م

QUALITY CARE
BUILDING CLEANING SERVICES LLC

Abu Dhabi - Dubai - Ajman - Ras Al Khaimah

International Indian School

Filter Water Cooler

WATER TANK CLEANING& DISINFECTION





كواليتي كير للخدمات تنظيف المباني ش ذ م م
QUALITY CARE
BUILDING CLEANING SERVICES LLC

المحافظة - أبوظبي - الإمارات العربية المتحدة

International Indian School

Filter Water Cooler

WATER TANK CLEANING& DISINFECTION



Sr. No. 00061

Operator's Permit

As

Water Tank Cleaning Company

This is to certify that

Quality Care Building Cleaning Services LLC.

Commercial License No. 651361

Complies with DM- Food Safety Department requirements for Water Tank Cleaning in the
Emirate of Dubai

Registration and Permits and Section



Issue Date: 04/01/2024

Expiry Date: 03/01/2025

DM-FSD-FO68, Rev: 03, Issue Date : 16/08/09

Kindly be informed that the attached permit (Water Tank Cleaning and Disinfection Permit) is approved with
regards of Food Safety requirements.

Note: For any inquiry kindly contact Registration and Permits Section via email address

FoodPermits@dm.gov.ae



شهادة مطابقة CERTIFICATE OF CONFORMITY

Certificate Number:	23-05-70639/E23-04-072331	رقم الشهادة:
Registration Date:	01/05/2023	تاريخ التسجيل:
Valid Until:	30/04/2024	صالحة لغاية:
Issued To:	SAMA AL SAHEL IND. P.O. Box 25080 ,INDUSTRIAL AREA 13 SHARJAH Sharjah ,United Arab Emirates	أصدرت إلى :
Sector:	Chemical	قطاع: كيمياء
Product Category:	Personal Health Protection Products	تصنيف المنتج: منتجات الحماية الصحية الشخصية
Product Sub-Category:	Chemical Disinfectants and Antiseptics	التصنيف الفرعي للمنتج: المعقمات و المطهرات الكيماوية

Please check Schedule of certification for all product details يرجى التحقق من بيان التسجيل المرفق لجميع تفاصيل المنتجات



Products are registered under the Emirates
Conformity Assessment Scheme (ECAS) based on
compliance to the Approved Standards

المنتجات مسجلة في نظام تقويم المطابقة الإماراتي (إيكاس)
بناء على مطابقتها للمواصفات المعتمدة

This is an electronic certificate and does not require stamp and
signature. Certificate will be invalid in case of any modification

هذه الشهادة صدرت إلكترونياً ولا تحتاج لختم أو توقيع، أي كشط أو تغيير
في هذه الشهادة يلغيها.



بيان التسجيل
SCHEDULE OF CERTIFICATION
Ministry of Industry and Advanced Technology

Company Name: SAMA AL SAHEL IND. **اسم الشركة:**

Product Category: Personal Health Protection Products **تصنيف المنتج:** منتجات الحماية الصحية الشخصية

Certificate No.: 23-05-70639/E23-04-072331 **رقم التسجيل:**

Registration Date: 01/05/2023 **تاريخ التسجيل:**

Valid Until: 30/04/2024 **صالح لغاية:**

Sr.No.	الاسم التجاري Brand Name	رقم الموديل Model Number	تفاصيل المنتج Product Details	الأبعاد/الحجم Dimension/Size	التقارير Reports	المواصفات المطبقة Applicable Standards	بلد المنشأ Country Of Origin
1	HYGIENX	RXSOL-15-1569-005	HygienX Water Tank Cleaner & Disinfectant	5 Liters	405428	UAE.S EN 1276	United Arab Emirates
Nothing Follows							



This is an electronic certificate and does not require stamp and signature. Certificate will be invalid in case of any modification

هذه الشهادة صدرت إلكترونياً ولا تحتاج لختم أو توقيع، أي كشط أو تغيير في هذه الشهادة يلغيها.



بيان التسجيل
SCHEDULE OF CERTIFICATION
Ministry of Industry and Advanced Technology



This is an electronic certificate and does not require stamp and signature. Certificate will be invalid in case of any modification



هذه الشهادة صدرت إلكترونياً ولا تحتاج لختم أو توقيع، أي كشط أو تغيير في هذه الشهادة يلغيها.



HYGIENX

Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

SECTION 1: IDENTIFICATION OF THE SUBSTANCE/MIXTURE AND OF THE COMPANY

Product Name: HygienX Water Tank Cleaner & Disinfectant

Identified Uses: Water Tank Cleaning and Disinfectant

Manufacturer:

SAMA AL SAHEL IND.

Exclusive Distributor:

EMIRATES SAFE CLEANING SOLUTIONS

Address:

Industrial Area No. 13 Sharjah, United Arab Emirates

Telephone Number:

+971 6 566 4545

Email Address:

info@samaind.com

SECTION 2: HAZARDS IDENTIFICATION

Product is not classified as dangerous.

SECTION 3: COMPOSITION/INFORMATION ON INGREDIENTS

Components	CAS No.	Weight %
Calcium hypochlorite	7778-54-3	0.5%
Ethylenediaminetetraacetic acid	60-00-4	1.0%
Nonylphenol ethoxylate	68412-53-3	2.0%
Cocoamidopropyl Betaine	61789-40-0; 86243-76-7	3.0%
Benzalkonium chloride	8001-54-5	6.0%
Sodium Lauryl Ether Sulfate	9004-82-4	2.0%
Triethanolamine	102-71-6	4.0%
Aqua (Water)	7732-18-5	77%



Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

SECTION 4: FIRST AID MEASURES

Inhalation: N.A

Eye: Irrigate with flowing water for at least 15 minutes. Seek medical attention if irritation or soreness persists.

Skin: Wear rubber gloves when handling the product. Launder contaminated before re-use.

Ingestion: Do not induce vomiting, unless instructed to do so by medical personnel. Rinse mouth with water and drink 1-2 glasses of water or milk. Seek medical attention.

Note to Doctor: For further inflation call 00971 6 5664545 or info@samaind.com

SECTION 5: FIREFIGHTING MEASURES

Flash Point	:	None flammable in preparation.
Autoignition	:	Not established.
Flammability Limits	:	Not applicable to the preparation.
Hazardous Combustion Products	:	During a fire, smoke may contain the original material in addition to unidentified toxic and/or irritating compounds. Hazardous combustion products may include and are not limited to: carbon monoxide, carbon dioxide and water vapor.
Media to Avoid	:	Avoid use of directed water jet.
Fire-fighting Instructions	:	Keep people away. Isolate fire area and deny unnecessary entry.

SECTION 6: ACCIDENTAL RELEASE MEASURES

Protect People: Evacuate personnel (large spillage). Avoid prolonged contact with the liquid. Protective clothing should be worn when dealing with any very large spillage.



Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

Protect the Environment: If very heavy contamination of drainage systems or watercourses is unavoidable, such as quantities of 1,000 liters or more to be flashed at one time, immediately inform appropriate authorities. Small spills may however be safely flushed away with plenty of water.

Clean Up: Absorb with material such as dirt or sand. Remove contaminated material to safe location for subsequent disposal.

SECTION 7: HANDLING AND STORAGE

Handling: It is advised that gloves be worn if handling the neat product for prolonged period.

Storage: Store in a cool, dry, well-ventilated area, above 0°C. Avoid exposure to direct sunlight and sources of heat. Keep container tightly closed when not in use.

SECTION 8: EXPOSURE CONTROLS/PERSONNEL PROTECTION

Engineering Control: Good general ventilation should be sufficient for most condition.

Personal Protective Equipment:

Eye/Face protection: Goggle should be worn for prolonged exposure.

Skin protection: It is recommended to wear gloves for periods of prolonged direct exposure to prevent defatting of skin.

Respiratory protection: Not required for normal use condition.

SECTION 9: PHYSICAL AND CHEMICAL PROPERTIES

Information on basic physical and chemical properties

Physical State: Liquid
Color: Yellow
Odor: Lemon
Density: 1.01-1.05
Solubility in water: completely soluble in all proportion



Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

pH: between 7.0-7.3

SECTION 10: STABILITY AND REACTIVITY

Stable: Stable under recommended storage and usage conditions.

Condition to Avoid: Prevent exposure to direct sunlight, heat and freezing condition.

Materials to Avoid: Avoid oxidizing agent, strong acids, aldehydes, ketones and other known incompatible chemicals.

Decomposition Products: Will not decompose under normal use condition.

Hazard Polymerization: Will not occur.

SECTION 11: TOXICOLOGICAL INFORMATION

No significant health hazard when the product is appropriately used for the application it was designed for.

Acute Effects: May cause mild irritation to the skin on very long prolonged contact. Ingestion of large amounts may cause mild gastric irritation.

Chronic Effects: Liquid may cause mild irritation and dry skin that may lead to skin dermatitis type condition.

Other Toxic Effects: None Known.

SECTION 12: ECOLOGICAL INFORMATION

Environmental Fate (Movement and Partitioning)

Completely miscible in water. Non bio-accumulative.

Degradation and Persistence (Eco toxicity)

High concentration in receiving waters have low toxicity to marine organism. Detergent component is readily biodegradable according to appropriate EC legislation.



Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

SECTION 13: DISPOSAL CONSIDERATIONS

Do not discharge large volumes into sewers, on the ground or into body of water. All disposal methods must be in compliance with the local regulations.

For unused and uncontaminated product, the preferred disposal options include sending to a licensed, permitted recycler or reclaimed.

SECTION 14: TRANSPORT INFORMATION

No transport warning sing required.

SECTION 15: REGULATORY INFORMATION

- S 2 Keep out of reach of children.
- S 26 In case of contact with eyes, rinse immediately with plenty of water and seek medical advice.
- S 46 If swallowed, seek medical advice immediately and show this container or label.

SECTION 16: OTHER INFORMATION

Legal disclaimer: The above information is believed to be correct but does not purpose to be all inclusive and shall be used only as a guide. This company shall not be held liable for any damage resulting from handling or from contact with the above product.

End Of MSDS.



WATER STORAGE TANK CLEANING & DISINFECTION REPORT

Client Name: International Indian School

Location : Abu Dhabi , UAE

Cleaning Date: 26th April 2024



INTERNATIONAL
INDIAN SCHOOL
ABU DHABI

Submitted to: **Mr. Riyas Parayil**
(Admin Supervisor/OSH Officer)

Submitted by: **Sarfaraz Faiz Ahmad**
(General Manager)



CERTIFICATE OF CLEANING AND DISINFECTION

This Cleaning and Disinfection Certificate is issued to:

International Indian School

Located at: Abu Dhabi, United Arab Emirates

We, Quality Care Building Cleaning Services LLC, hereby certify that we have accomplished cleaning and disinfection of the water storage tanks at *International Indian School*.

Location, Type & Size of Tank : Underground RCC Tank- 7m x 5m x 2m – 1no.

Cleaning Frequency as per client Requirement : Every 6 months

Date of Cleaning : 26th April 2024

Validity of Certificate : 6 Months from date of issue

Under Reference Number: QC-2Q/ WT

Chemical Used : **HygienX**

The procedures applied in this cleaning and disinfection of water storage tanks comply with QCBCS methodology and Technical Guidelines for Legionella control in water system

DM-HSD-GU44-LCWS2.

Next Cleaning as per client requirement: 25th October 2024

Note: We are not giving any warranty for the cleaning works, once we submit the report & we are giving validity only for certificates.



Signed on behalf of
QUALITY CARE BUILDING CLEANING SERVICES LLC



CERTIFICATE OF CLEANING AND DISINFECTION

This Cleaning and Disinfection Certificate is issued to:

International Indian School

Located at: Abu Dhabi, United Arab Emirates

We, Quality Care Building Cleaning Services LLC, hereby certify that we have accomplished cleaning and disinfection of the water storage tanks at *International Indian School*.

Location, Type & Size of Tank : Rooftop GRP Tank- 3m x 2m x 2m – 4nos.

Cleaning Frequency as per client Requirement : Every 6 months

Date of Cleaning : 26th April 2024

Validity of Certificate : 6 Months from date of issue

Under Reference Number : QC-2Q/ WT

Chemical Used : **HygienX**

The procedures applied in this cleaning and disinfection of water storage tanks comply with QCBCS methodology and Technical Guidelines for Legionella control in water system

DM-HSD-GU44-LCWS2.

Next Cleaning as per client requirement: 25th October 2024

Note: We are not giving any warranty for the cleaning works, once we submit the report & we are giving validity only for certificates.



Signed on behalf of
QUALITY CARE BUILDING CLEANING SERVICES LLC



كواليتي كير لخدمات تنظيف المباني ش ذ م م

QUALITY CARE
BUILDING CLEANING SERVICES LLC

As a business solution, we provide a comprehensive

International Indian School

Underground -RCC Tank- 7m x 5m x 2m – 1no.

WATER TANK CLEANING& DISINFECTION





كواليتي كير لخدمات تنظيف المباني ش ذ م م

QUALITY CARE
BUILDING CLEANING SERVICES LLC

As a responsible company, we are committed to providing the best service to our clients.

International Indian School

Rooftop - GRP Tank 1-3mx2mx2m.

WATER TANK CLEANING& DISINFECTION





كواليتي كير لخدمات تنظيف المباني ش ذ م م

QUALITY CARE
BUILDING CLEANING SERVICES LLC

As a domestic subsidiary of a foreign company

International Indian School

Rooftop - GRP Tank 2-3mx2mx2m

WATER TANK CLEANING& DISINFECTION





كواليتي كير لخدمات تنظيف المباني ش ذ م م

QUALITY CARE
BUILDING CLEANING SERVICES LLC

As a business solution for your business

International Indian School

Rooftop - GRP Tank 3-3mx2mx2m

WATER TANK CLEANING& DISINFECTION





كواليتي كير لخدمات تنظيف المباني ش ذ م م

QUALITY CARE
BUILDING CLEANING SERVICES LLC

As a business, Quality Care is committed to providing the best service to our clients.

International Indian School

Rooftop - GRP Tank 4-3mx2mx2m.

WATER TANK CLEANING& DISINFECTION





شهادة تسجيل منشآت تجارية متخصصة في تنظيف خزانات مياه الشرب
Certificate of registration for the establishments specialized in drinking water tanks cleaning

Trade License No.	202304327579	رقم الرخصة التجارية
Est. Trade Name	كوالتي كير لخدمات تنظيف المباني - فرع أبو ظبي 1	إسم المنشأة التجارية
Registration Certificate Issuance Date	2023-12-07	تاريخ إصدار شهادة التسجيل
Registration Certificate Expiry Date	2025-12-06	تاريخ إنتهاء شهادة التسجيل
Est. Address	أبو ظبي، مدينة محمد بن زايد، ز 9_1، 0 : ~، 240408، لنك انفستمنتس - ذ م م، طابق،	عنوان المنشأة التجارية
Est. Details	بيانات المنشأة	
Email / البريد الالكتروني	Alternate Mobile No رقم الجوال / البديل	Mobile No / رقم الجوال
qualitycareabudhabi@gmail.com		+971551816944
		ثمر عباس ارشد محمود

Terms and Conditions:

- The entity should comply with laws, regulations & codes as follows:
 - Law No. (2) of 2012 concerning the preservation of the general appearance, health & public calmness in Abu Dhabi, as well as its amendments & its executive regulations.
 - Administrative Decree No. (26) for the year 2018 concerning to public health and safety of drinking water tanks in the Emirate of Abu Dhabi.
 - Abu Dhabi guideline health control of building & public facilities.
 - Code of Practice for Inspection & cleaning of customer Water storage Tanks.
- Ensure that all the workers are registered and have obtained the required conformity certificate from Abu Dhabi quality & conformity Council as well as medical fitness certificate from Department of health.
- Follow all the technical procedures to prevent pollution & comply with the approved emergency response plan in case it occurs.
- Maintain the required operating registers in addition to all laboratory analysis results on a regular basis.
- The municipality reserves the right to temporarily suspend or cancel the registration in case the activity of the entity poses a threat to public health, or if the work is not carried out in accordance with all the requirements, approved standards, & code of practices.

الشروط والأحكام:

- تتعهد الشركة بالالتزام بالقوانين والتشريعات والأدلة التالية:
 - القانون رقم (2) لسنة 2012م بشأن الحفاظ على المظهر العام والصحة والسكينة العامة في إمارة أبوظبي وتعديلاته ولوائحه التنفيذية.
 - القرار الإداري رقم (26) لسنة 2018 بشأن الصحة والسلامة العامة لخزانات مياه الشرب الخاصة بإمارة أبوظبي.
 - دليل أبو ظبي الإرشادي للرقابة الصحية على المباني والمرافق العامة.
 - قواعد الممارسة الخاصة بتفتيش وتنظيف خزانات مياه الشرب الخاصة بالمستهلكين.
- ضمان تسجيل كافة العاملين وحصولهم على شهادة المطابقة من مجلس أبو ظبي للجودة والمطابقة وشهادة اللياقة الصحية من دائرة الصحة.
- إتباع كافة الإجراءات الفنية لمنع التلوث، والتقيد بخطة الطوارئ المعتمدة في حال حدوثه.
- الإحتفاظ بسجلات التشغيل المطلوبة بالإضافة إلى كافة نتائج التحليل المخبري بصورة مستمرة.
- تحتفظ البلدية بحقها في تعليق التسجيل مؤقتة أو إلغائه إذا كان عمل المنشأة يشكل خطراً على الصحة العامة، أو في حال عدم تنفيذ الأعمال وفقاً للإشتراطات والمعايير والأدلة المعتمدة.



شهادة مطابقة CERTIFICATE OF CONFORMITY

Certificate Number:	23-05-70639/E23-04-072331	رقم الشهادة:
Registration Date:	01/05/2023	تاريخ التسجيل:
Valid Until:	30/04/2024	صالحة لغاية:
Issued To:	SAMA AL SAHEL IND. P.O. Box 25080 ,INDUSTRIAL AREA 13 SHARJAH Sharjah ,United Arab Emirates	أصدرت إلى :
Sector:	Chemical	قطاع: كيمياء
Product Category:	Personal Health Protection Products	تصنيف المنتج: منتجات الحماية الصحية الشخصية
Product Sub-Category:	Chemical Disinfectants and Antiseptics	التصنيف الفرعي للمنتج: المعقمات و المطهرات الكيماوية

Please check Schedule of certification for all product details يرجى التحقق من بيان التسجيل المرفق لجميع تفاصيل المنتجات



Products are registered under the Emirates
Conformity Assessment Scheme (ECAS) based on
compliance to the Approved Standards

المنتجات مسجلة في نظام تقويم المطابقة الإماراتي (إيكاس)
بناء على مطابقتها للمواصفات المعتمدة

This is an electronic certificate and does not require stamp and
signature. Certificate will be invalid in case of any modification

هذه الشهادة صدرت إلكترونياً ولا تحتاج لختم أو توقيع، أي كشط أو تغيير
في هذه الشهادة يلغيها.



بيان التسجيل
SCHEDULE OF CERTIFICATION
Ministry of Industry and Advanced Technology

Company Name: SAMA AL SAHEL IND. **اسم الشركة:**

Product Category: Personal Health Protection Products **تصنيف المنتج:** منتجات الحماية الصحية الشخصية

Certificate No.: 23-05-70639/E23-04-072331 **رقم التسجيل:**

Registration Date: 01/05/2023 **تاريخ التسجيل:**

Valid Until: 30/04/2024 **صالح لغاية:**

Sr.No.	الاسم التجاري Brand Name	رقم الموديل Model Number	تفاصيل المنتج Product Details	الأبعاد/الحجم Dimension/Size	التقارير Reports	المواصفات المطبقة Applicable Standards	بلد المنشأ Country Of Origin
1	HYGIENX	RXSOL-15-1569-005	HygienX Water Tank Cleaner & Disinfectant	5 Liters	405428	UAE.S EN 1276	United Arab Emirates
Nothing Follows							



This is an electronic certificate and does not require stamp and signature. Certificate will be invalid in case of any modification

هذه الشهادة صدرت إلكترونياً ولا تحتاج لختم أو توقيع، أي كشط أو تغيير في هذه الشهادة يلغيها.



بيان التسجيل
SCHEDULE OF CERTIFICATION
Ministry of Industry and Advanced Technology



This is an electronic certificate and does not require stamp and signature. Certificate will be invalid in case of any modification



هذه الشهادة صدرت إلكترونياً ولا تحتاج لختم أو توقيع، أي كشط أو تغيير في هذه الشهادة يلغيها.



Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

SECTION 1: IDENTIFICATION OF THE SUBSTANCE/MIXTURE AND OF THE COMPANY

Product Name: HygienX Water Tank Cleaner & Disinfectant

Identified Uses: Water Tank Cleaning and Disinfectant

Manufacturer:

SAMA AL SAHEL IND.

Exclusive Distributor:

EMIRATES SAFE CLEANING SOLUTIONS

Address:

Industrial Area No. 13 Sharjah, United Arab Emirates

Telephone Number:

+971 6 566 4545

Email Address:

info@samaind.com

SECTION 2: HAZARDS IDENTIFICATION

Product is not classified as dangerous.

SECTION 3: COMPOSITION/INFORMATION ON INGREDIENTS

Components	CAS No.	Weight %
Calcium hypochlorite	7778-54-3	0.5%
Ethylenediaminetetraacetic acid	60-00-4	1.0%
Nonylphenol ethoxylate	68412-53-3	2.0%
Cocoamidopropyl Betaine	61789-40-0; 86243-76-7	3.0%
Benzalkonium chloride	8001-54-5	6.0%
Sodium Lauryl Ether Sulfate	9004-82-4	2.0%
Triethanolamine	102-71-6	4.0%
Aqua (Water)	7732-18-5	77%



Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

SECTION 4: FIRST AID MEASURES

Inhalation: N.A

Eye: Irrigate with flowing water for at least 15 minutes. Seek medical attention if irritation or soreness persists.

Skin: Wear rubber gloves when handling the product. Launder contaminated before re-use.

Ingestion: Do not induce vomiting, unless instructed to do so by medical personnel. Rinse mouth with water and drink 1-2 glasses of water or milk. Seek medical attention.

Note to Doctor: For further information call 00971 6 5664545 or info@samaind.com

SECTION 5: FIREFIGHTING MEASURES

Flash Point	:	None flammable in preparation.
Autoignition	:	Not established.
Flammability Limits	:	Not applicable to the preparation.
Hazardous Combustion Products	:	During a fire, smoke may contain the original material in addition to unidentified toxic and/or irritating compounds. Hazardous combustion products may include and are not limited to: carbon monoxide, carbon dioxide and water vapor.
Media to Avoid	:	Avoid use of directed water jet.
Fire-fighting Instructions	:	Keep people away. Isolate fire area and deny unnecessary entry.

SECTION 6: ACCIDENTAL RELEASE MEASURES

Protect People: Evacuate personnel (large spillage). Avoid prolonged contact with the liquid. Protective clothing should be worn when dealing with any very large spillage.



Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

Protect the Environment: If very heavy contamination of drainage systems or watercourses is unavoidable, such as quantities of 1,000 liters or more to be flashed at one time, immediately inform appropriate authorities. Small spills may however be safely flushed away with plenty of water.

Clean Up: Absorb with material such as dirt or sand. Remove contaminated material to safe location for subsequent disposal.

SECTION 7: HANDLING AND STORAGE

Handling: It is advised that gloves be worn if handling the neat product for prolonged period.

Storage: Store in a cool, dry, well-ventilated area, above 0°C. Avoid exposure to direct sunlight and sources of heat. Keep container tightly closed when not in use.

SECTION 8: EXPOSURE CONTROLS/PERSONNEL PROTECTION

Engineering Control: Good general ventilation should be sufficient for most condition.

Personal Protective Equipment:

Eye/Face protection: Goggle should be worn for prolonged exposure.

Skin protection: It is recommended to wear gloves for periods of prolonged direct exposure to prevent defatting of skin.

Respiratory protection: Not required for normal use condition.

SECTION 9: PHYSICAL AND CHEMICAL PROPERTIES

Information on basic physical and chemical properties

Physical State: Liquid
Color: Yellow
Odor: Lemon
Density: 1.01-1.05
Solubility in water: completely soluble in all proportion



Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

pH: between 7.0-7.3

SECTION 10: STABILITY AND REACTIVITY

Stable: Stable under recommended storage and usage conditions.

Condition to Avoid: Prevent exposure to direct sunlight, heat and freezing condition.

Materials to Avoid: Avoid oxidizing agent, strong acids, aldehydes, ketones and other known incompatible chemicals.

Decomposition Products: Will not decompose under normal use condition.

Hazard Polymerization: Will not occur.

SECTION 11: TOXICOLOGICAL INFORMATION

No significant health hazard when the product is appropriately used for the application it was designed for.

Acute Effects: May cause mild irritation to the skin on very long prolonged contact. Ingestion of large amounts may cause mild gastric irritation.

Chronic Effects: Liquid may cause mild irritation and dry skin that may lead to skin dermatitis type condition.

Other Toxic Effects: None Known.

SECTION 12: ECOLOGICAL INFORMATION

Environmental Fate (Movement and Partitioning)

Completely miscible in water. Non bio-accumulative.

Degradation and Persistence (Eco toxicity)

High concentration in receiving waters have low toxicity to marine organism. Detergent component is readily biodegradable according to appropriate EC legislation.



Water Tank Cleaner & Disinfectant Material Safety Data Sheet

Date of Issue:	April 20, 2022	Document No.:	SAMAMSDS-001	Version No.:	2
----------------	----------------	---------------	--------------	--------------	---

SECTION 13: DISPOSAL CONSIDERATIONS

Do not discharge large volumes into sewers, on the ground or into body of water. All disposal methods must be in compliance with the local regulations.

For unused and uncontaminated product, the preferred disposal options include sending to a licensed, permitted recycler or reclaimed.

SECTION 14: TRANSPORT INFORMATION

No transport warning sing required.

SECTION 15: REGULATORY INFORMATION

- S 2 Keep out of reach of children.
- S 26 In case of contact with eyes, rinse immediately with plenty of water and seek medical advice.
- S 46 If swallowed, seek medical advice immediately and show this container or label.

SECTION 16: OTHER INFORMATION

Legal disclaimer: The above information is believed to be correct but does not purpose to be all inclusive and shall be used only as a guide. This company shall not be held liable for any damage resulting from handling or from contact with the above product.

End Of MSDS.



TEST REPORT



Report No :URS/M/RID/24/5/5474

Dated : 18/05/2024

Issued To : Quality Care Building Cleaning Services		Deira, Dubai	
Attention	Mr. Sammar		
Sample Condition(Receipt Temperature)	12.5°C	Sample Condition (On Site)	28.0°C
Customer Ref.No.	59310/ Dated 03/05/2024 Trf No.URS/SR/53917 / Sample ID: URS/F/M/SID/24 /5/1167	Sample Package & Quantity	1 L
Sample Name	Water International Indian School Tank-01- Legionella	Sampled by	Naveed Shaffi
Sample Type	Pre-Flush	Neutralizing Agent	Sodium Thiosulphate
Sample description	Colorless Liquid	Delivered by	Lab Representative
Batch No. /Lot No.	NA	Sampling Protocol	BS 7592:2022
Manufacturing Date	NA	Date of Sample Receipt	03/05/2024
Best before date	NA	Date of Analysis	03/05/2024
Other Details	NA	Date of Completion	18/05/2024

Note: The submitted samples are Drawn by the Laboratory.

Note: For any queries, please contact lab manager at labmanager@urslabs.com.

LPS: ACCEPTABLE LIMIT					Dubai Municipality- Technical guidelines for legionella control in water system (DM-HSD -GU44-LCW-S2)
S.NO	Parameters	Unit	Test Method	Result	
1	Legionella	/Litre	ISO 11731:2017	Absent	100 - 1000
Legionella pneumophila Serotype 1				Absent	
Legionella pneumophila Serotype 2-15				Absent	
Legionellasp				Absent	

Remarks: The sample analyzed is of satisfactory quality with respect to the above tested parameters and limit of specifications

Procedure Used: Matrix A; procedure 5, 7; Media: BCYE and GVPC

Test method Variation: None

Specification reference: Guidelines for the control of legionella in water system public health & safety department, Dubai municipality

Key words:

CFU –Colony forming Unit, ND-Not detected, EAPC-Estimated aerobic plate count, LPS-Limits as per standard, BAM – Bacteriological Analytical Manual, CMMEF-Compendium of methods for the Microbiological examination of foods. APHA-American public health association-Standard method for the examination of water and waste water 22 edition: 2012

Note: (1) The results relate only to the items tested, (2) The test report shall not be reproduced except in full without the written approval of the URS laboratory, (3) For details of the accredited scope, please contact laboratory or accreditation body website

Nidhila Ganga

Nidhila Ganga
Technical Manager- Microbiology

URS Testing Laboratory LLC
PO Box 377913
Tel : +971 48837115
E-Mail : info@urslabs.com
Web site : www.urslabs.com



-----END OF THE TEST REPORT-----